


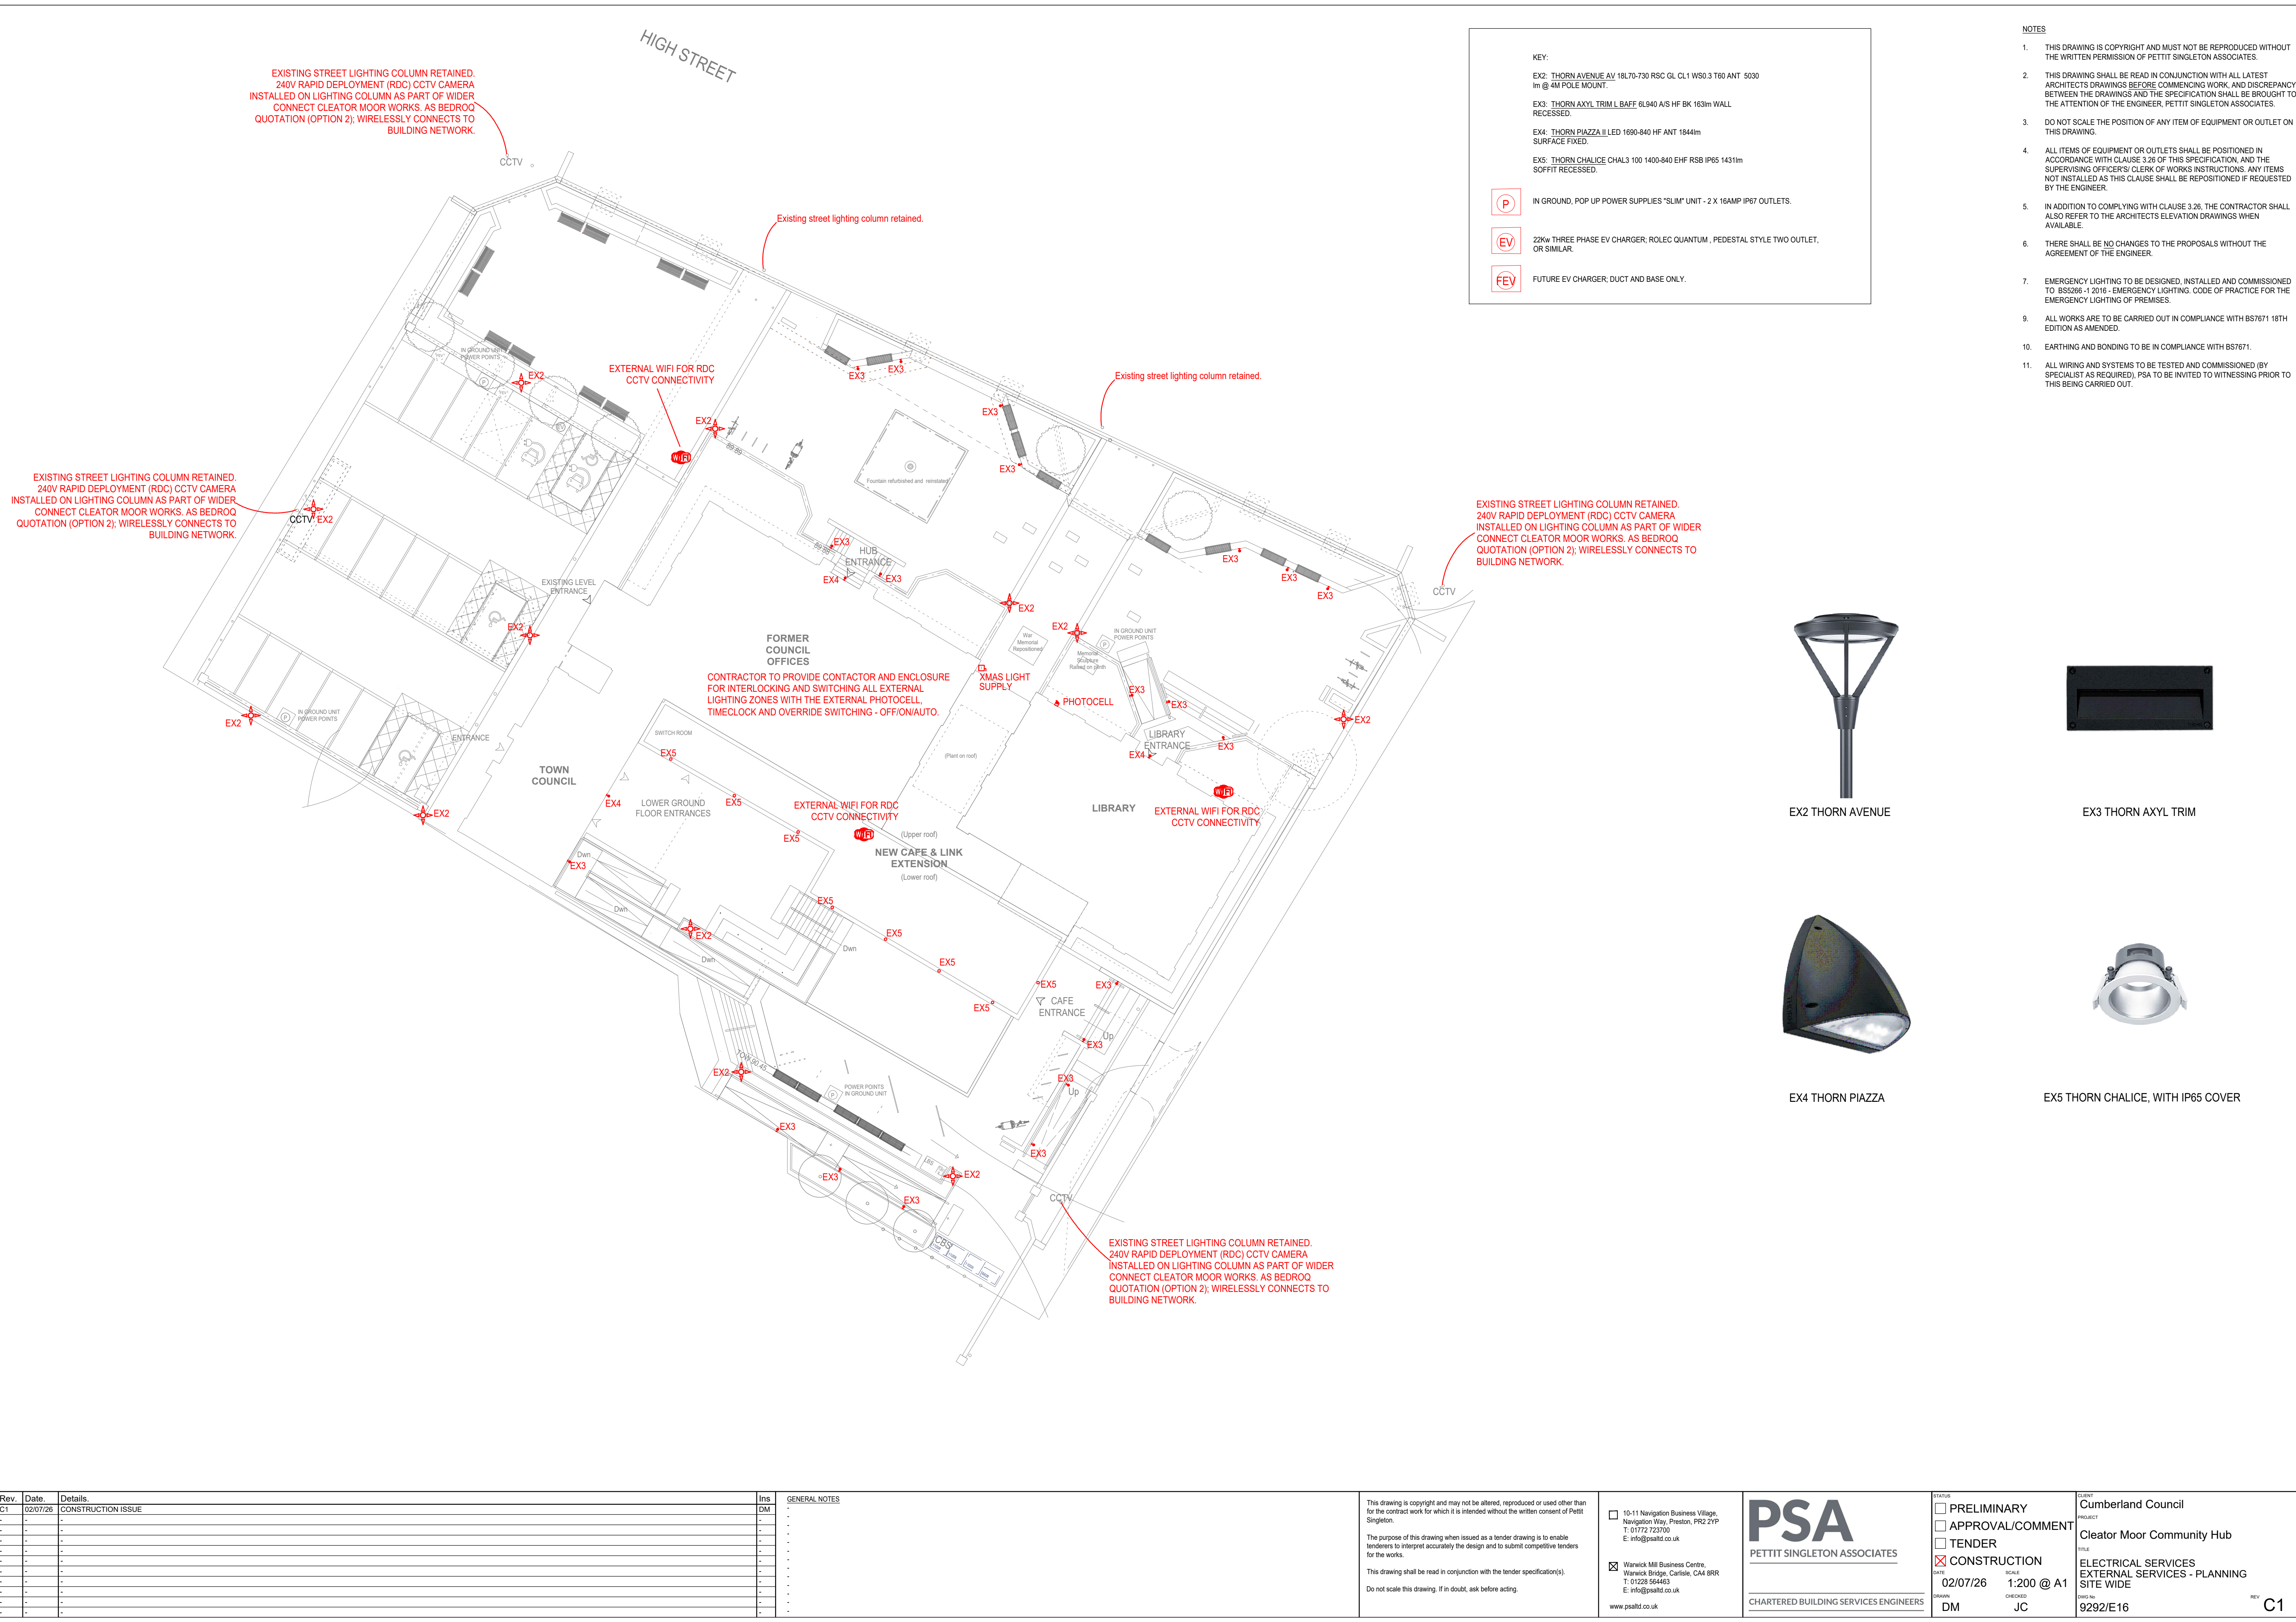

KEY:

EX2: THORN AVENUE AV 18L70-730 RSC GL CL1 WS0.3 T60 ANT 5030
lm @ 4M POLE MOUNT.

EX3: THORN AXYL TRIM L BIAFF BL940 A/S HF BK 163lm WALL
RECESSED.

EX4: THORN PIAZZA II LED 1690-840 HF ANT 1844lm
SURFACE FIXED.

EX5: THORN CHALICE CHAL3 100 1400-840 EHF RSB IP65 1431lm
SOFFIT RECESSED.

P

IN GROUND, POP UP POWER SUPPLIES "SLIM" UNIT - 2 X 16AMP IP67 OUTLETS.

EV

22kw THREE PHASE EV CHARGER; ROLEC QUANTUM , PEDESTAL STYLE TWO OUTLET,
OR SIMILAR.

FEV

FUTURE EV CHARGER, DUCT AND BASE ONLY.

- NOTES
1.

THIS DRAWING IS COPYRIGHT AND MUST NOT BE REPRODUCED WITHOUT THE WRITTEN PERMISSION OF PETTIT SINGLETON ASSOCIATES.
2.

THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL LATEST ARCHITECTS DRAWINGS BEFORE COMMENCING WORK, AND DISCREPANCY BETWEEN THE DRAWINGS AND THE SPECIFICATION SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER, PETTIT SINGLETON ASSOCIATES.
3.

DO NOT SCALE THE POSITION OF ANY ITEM OF EQUIPMENT OR OUTLET ON THIS DRAWING.
4.

ALL ITEMS OF EQUIPMENT OR OUTLETS SHALL BE POSITIONED IN ACCORDANCE WITH CLAUSE 3.26 OF THIS SPECIFICATION, AND THE SUPERVISING OFFICER/S/ CLERK OF WORKS INSTRUCTIONS, ANY ITEMS NOT INSTALLED AS THIS CLAUSE SHALL BE REPOSITIONED IF REQUESTED BY THE ENGINEER.
5.

IN ADDITION TO COMPLYING WITH CLAUSE 3.26, THE CONTRACTOR SHALL ALSO REFER TO THE ARCHITECTS ELEVATION DRAWINGS WHEN AVAILABLE.
6.

THERE SHALL BE NO CHANGES TO THE PROPOSALS WITHOUT THE AGREEMENT OF THE ENGINEER.
7.

EMERGENCY LIGHTING TO BE DESIGNED, INSTALLED AND COMMISSIONED TO BS5266 -1 2016 - EMERGENCY LIGHTING. CODE OF PRACTICE FOR THE EMERGENCY LIGHTING OF PREMISES.
9.

ALL WORKS ARE TO BE CARRIED OUT IN COMPLIANCE WITH BS7671 18TH EDITION AS AMENDED.
10.

EARTHING AND BONDING TO BE IN COMPLIANCE WITH BS7671.
11.

ALL WIRING AND SYSTEMS TO BE TESTED AND COMMISSIONED (BY SPECIALIST AS REQUIRED), PSA TO BE INVITED TO WITNESSING PRIOR TO THIS BEING CARRIED OUT.



EX2 THORN AVENUE



EX3 THORN AXYL TRIM



EX4 THORN PIAZZA



EX5 THORN CHALICE, WITH IP65 COVER

Rev.	Date	Details
C1	02/07/26	CONSTRUCTION ISSUE
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-

Ins	GENERAL NOTES
DM	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-

This drawing is copyright and may not be altered, reproduced or used other than for the contract work for which it is intended without the written consent of Pettit Singleton.

The purpose of this drawing when issued as a tender drawing is to enable tenderers to interpret accurately the design and to submit competitive tenders for the works.

This drawing shall be read in conjunction with the tender specification(s).

Do not scale this drawing. If in doubt, ask before acting.

10-11 Navigation Business Village,
Navigation Way, Preston, PR2 2YP
T: 01772 723700
E: info@psaltd.co.uk

Warwick Mill Business Centre,
Warwick Bridge, Carlisle, CA4 8RR
T: 01228 564463
E: info@psaltd.co.uk

www.psaltd.co.uk

PSA

PETTIT SINGLETON ASSOCIATES

CHARTERED BUILDING SERVICES ENGINEERS

STATUS

☐ PRELIMINARY

☐ APPROVAL/COMMENT

☐ TENDER

☒ CONSTRUCTION

DATE

02/07/26

SCALE

1:200 @ A1

CHECKED

JC

DRAWN

DM

CLIENT

Cumberland Council

PROJECT

Cleator Moor Community Hub

TITLE

ELECTRICAL SERVICES
EXTERNAL SERVICES - PLANNING
SITE WIDE

DWG No

9292/E16

REV

C1